REV.	ZONE	ECN NO.	DATE	BY	CKR	APP.

Phil Pape, Controls Division 5/31/2002 9:14 AM 957_rack3.dwg

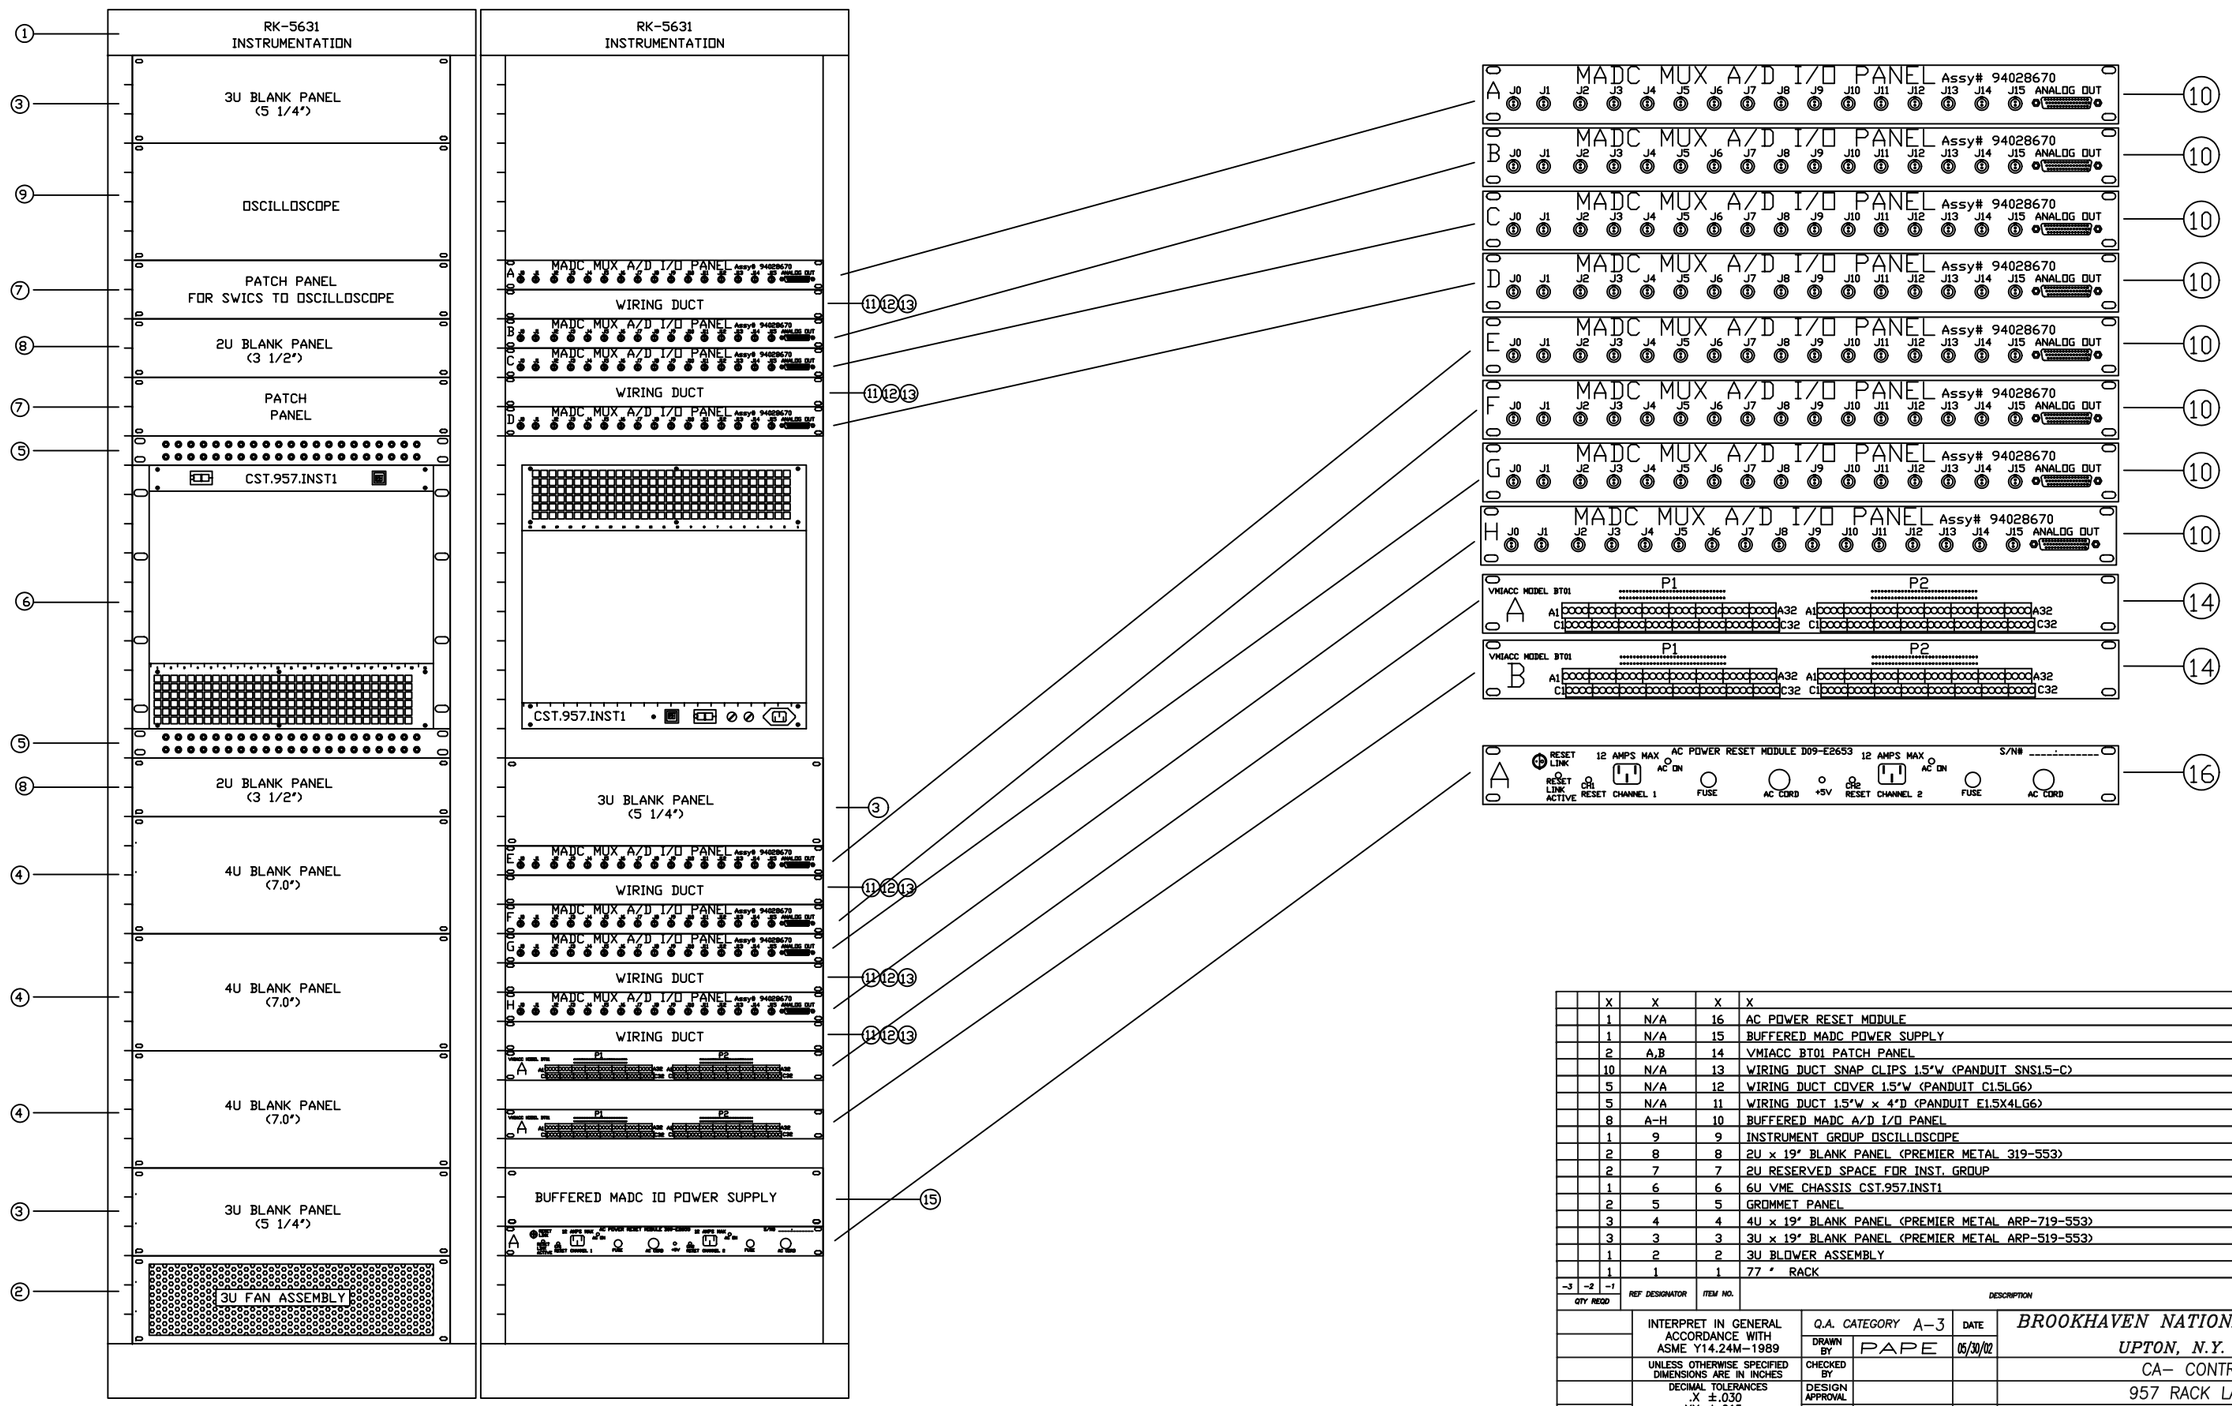

QTY REQD -3	-2	-1	REF DESIGNATOR	ITEM NO.	DESCRIPTION	MAT'L DWG NO.,BNL NO.
		X	X	X	X	X
		1	N/A	16	AC POWER RESET MODULE	D09-E2653
		1	N/A	15	BUFFERED MADC POWER SUPPLY	940288808
		2	A,B	14	VMIACC BT01 PATCH PANEL	
		10	N/A	13	WIRING DUCT SNAP CLIPS 1.5"W (PANDUIT SNS1.5-C)	
		5	N/A	12	WIRING DUCT COVER 1.5"W (PANDUIT C1.5LG6)	
		5	N/A	11	WIRING DUCT 1.5"W x 4"D (PANDUIT E1.5X4LG6)	
		8	A-H	10	BUFFERED MADC A/D I/O PANEL	94028670
		1	9	9	INSTRUMENT GROUP OSCILLOSCOPE	
		2	8	8	2U x 19" BLANK PANEL (PREMIER METAL 319-553)	
		2	7	7	2U RESERVED SPACE FOR INST. GROUP	
		1	6	6	6U VME CHASSIS CST.957.INST1	
		2	5	5	GROMMET PANEL	
		3	4	4	4U x 19" BLANK PANEL (PREMIER METAL ARP-719-553)	
		3	3	3	3U x 19" BLANK PANEL (PREMIER METAL ARP-519-553)	
		1	2	2	3U BLOWER ASSEMBLY	
		1	1	1	77 " RACK	

INTERPRET IN GENERAL ACCORDANCE WITH ASME Y14.24M-1989

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES

DECIMAL TOLERANCES
X ±.030
.XX ±.015
.XXX ±.005
ANGULAR TOLERANCE
± .5°

OUTSTANDING ECN

NA FINISH

BREAK SHARP EDGES
MAX. XX MIN. XX

Q.A. CATEGORY A-3

		DATE
DRAWN BY	PAPE	05/30/02
CHECKED BY		
DESIGN APPROVAL		
ENGINEER APPROVAL		
SUPVR. APPROVAL		

NEXT ASSEMBLY

BROOKHAVEN NATIONAL LABORATORY
UPTON, N.Y. 11973

CA- CONTROLS

957 RACK LAYOUT

CST.957.INST1

SIZE D

Drawing Number
DRAWING NUMBER

REV. A

MATERIAL: ——— SCALE: FULL WEIGHT: - SHEET 1 OF 1

*AUTOCAD